


MCP Opening/ Closing Procedure

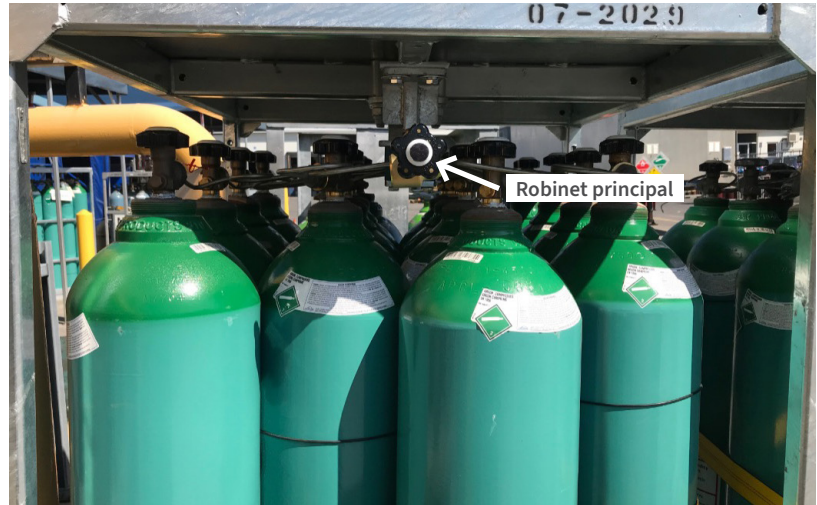

Opening

1. Install the regulator on the main valve (in closed position)
2. Slowly open the cylinder valves
3. Slowly open the main valve
4. Set the regulator service pressure

Check the seal between the main valve and the regulator with an approved leak detection solution.

Do not use lubricant or sealant between the CGA connections and the regulator connections.

The valve must be fully opened and rotated back ¼ turn to ensure a tight seat.

Closing

1. Close the main valve
2. Close the cylinder valves
3. Depressurize and remove the regulator

Safety is Messer's number one priority.

- The pressure of this MCP can reach up to 4500 psi.
- This high pressure can cause serious and/or fatal injuries if handled by unqualified individuals.
- DO NOT modify this MCP under any circumstances.
- If any modification is made to this MCP while in your possession, a charge of up to \$5,000 will apply.

Messer Canada Inc.
5860 Chedworth Way
Mississauga, ON
L5R 0A2 Canada
Phone 1-888-256-7359
info@messer-ca.com
www.messer-ca.com
www.shop.messer-ca.com