


# SEPARATE INCOMPATIBLE GASES

MAINTAIN 20 FEET OF SEPARATION

— OR —

USE A PROTECTIVE BARRIER

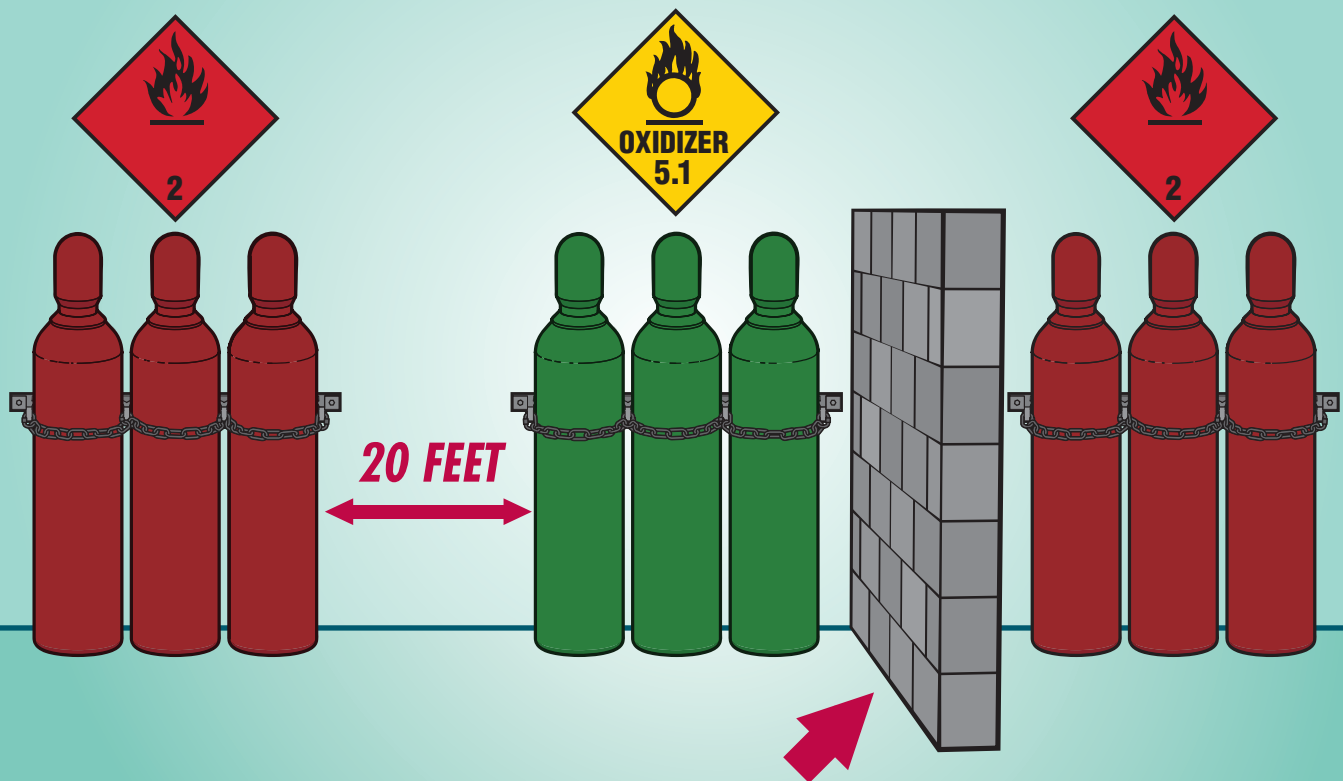

**BARRIER WITH A FIRE RESISTANCE RATING OF AT LEAST  
30 MINUTES THAT INTERRUPTS LINE OF SIGHT**




For additional information, see  
CGA P-1, *Standard for Safe  
Handling of Compressed  
Gases in Containers*, and  
NFPA 55, *Compressed Gases  
and Cryogenic Fluids Code*.



Supplied by:

# SÉPAREZ LES GAZ INCOMPATIBLES

## MAINTENEZ 6.1 MÈTRES DE SÉPARATION — OU — UTILISEZ UNE BARRIÈRE DE PROTECTION

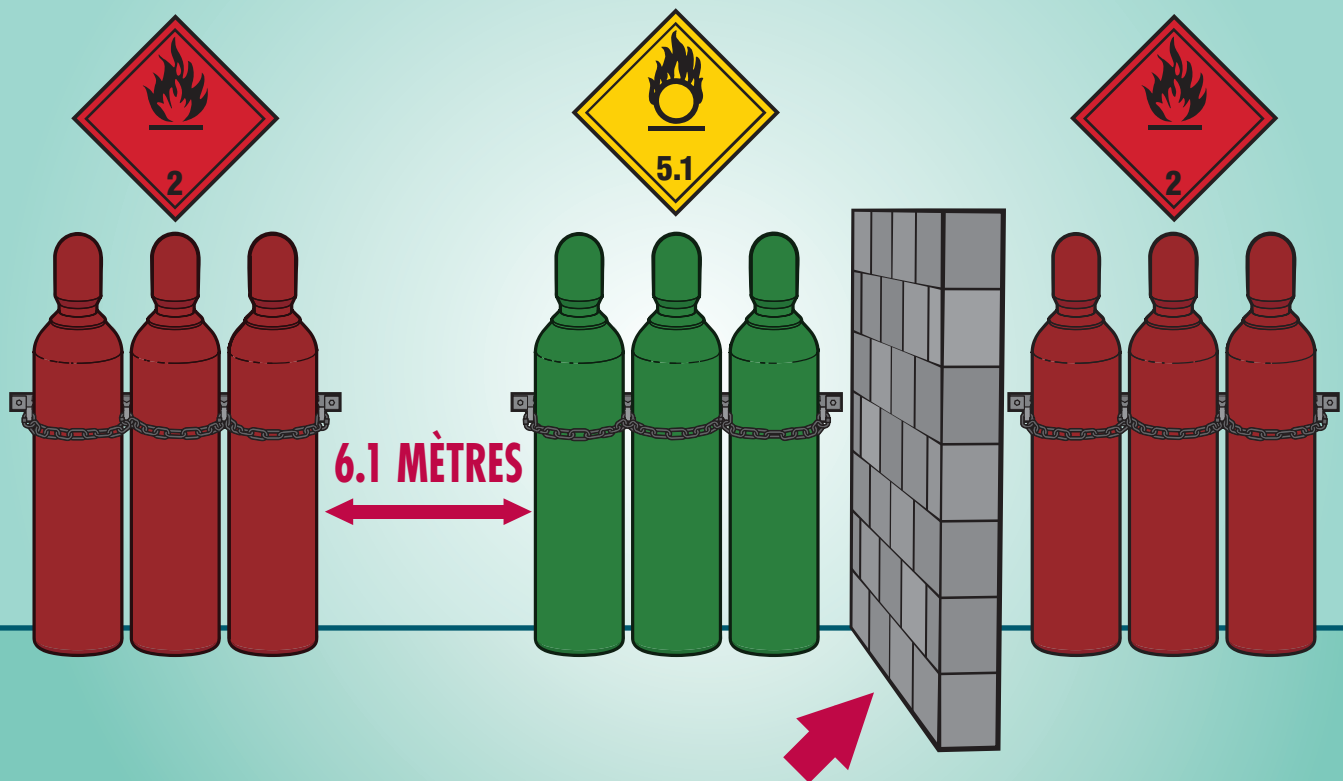


**BARRIÈRE AVEC UN DEGRÉ DE RÉSISTANCE AU FEU D'AU MOINS 30 MINUTES  
INTERROMPANT LA LIGNE DE VUE.**

# SEPARAR GASES INCOMPATIBLES

## MANTENGA 6 METROS DE SEPARACIÓN

— 0 —

## UTILICE BARRERA PROTECTORA

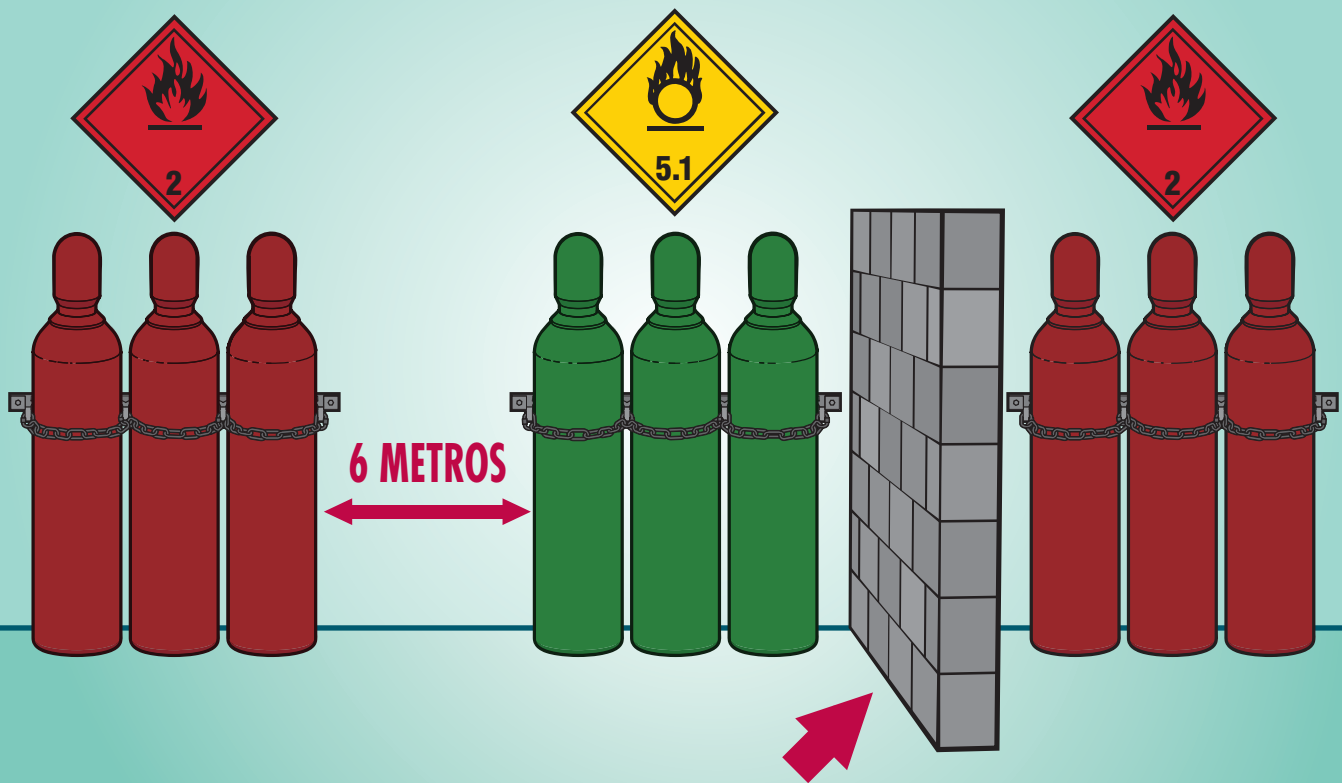

**BARRERA CON UNA CLASIFICACIÓN DE RESISTENCIA AL FUEGO DE AL MENOS 30 MINUTOS QUE INTERRUMPA LA LÍNEA DE VISIÓN**